



**Approval** 

Construction

## **SUBMITTAL - 12,000BTU WALL-MOUNT - M28**

Job Name:							
Location:							
Engineer:							
Submitted By:							
Submitted	То:						
WARRANT	Y						
Standard 1	0 Years Part	s & Compre	essor				
Terms & Condit	ions Apply.						
TYPE							
Air Source							
Cold Climat	e Air Source	e Heat Pum	p 🗸				
MODELS				1			
Indoor		DMA12HI	W25230E8				
Outdoor		DMA12H	OS28230E8				
<b>CAPACITY I</b>	RANGE <sup>1</sup>						
Output (Bt	u/h)	Min.	Rated	Max.			
	Cooling	3620	12000	14146			
	Heating	3920	12000	15613			
<b>HEATING P</b>	ERFORMAN	ICE <sup>2</sup>					
Output (Bt	u/h)	Min.	Rated	Max.			
	17°F (8.3°C)	3920	12000	15613			
1	7°F (-8.3°C)	3268	10000	13112			
	5°F (-15°C)	3084	12000	11782			
-2	2°F (-30°C)		6100	6100			
<b>OUTDOOR</b>	TEMPERAT	URE OPERA	TING RANG	E			
Cooling	-30 <b>~</b> 50	°C	-22 <b>~</b> 122	°F			
Heating <sup>3</sup>	-30 <b>~</b> 24	°C	-22 <b>~</b> 75	°F			
LINE SET &	REFRIGERA	NT					
Liquid (in.)	1/4"		Gas (in.)	1/2"			
Connection	Flared						
Pre-Charge	25						
Max. Lengt	82						
Max. Heigh	32.8						
Refrigerant	R410A						
Pre-Charge	41.62						
Additional	0.16						
Oil Type	350						
Drain Pipe O.D. (mm) 19							



Date:
Unit Tag:
Drawing No.:

Submitted For: Reference



Images for reference only.

				or reference only.		
CERTIFIED						
AHRI NO.		(ii				
20774	12496	C U	<b>L)</b> US TED	ENERGY STAR		
<b>EFFICIENCY</b>	RATINGS					
SEER2				25.5		
EER2				14		
HSPF2 (4)				10.4		
HSPF2 (5)				8		
COP <sup>2</sup>	47°F	17°F	5°F	-22°F		
	(8.3°C)	(-8.3°C)	(-15°C)	(-30°C)		
	3.86	2.4	1.8	1.15		
ELECTRICAL	L					
Power Supply		(V/Ph/Hz)	208	8-230/1/60		
Voltage Range		(V)		187-253		
MCA (A)	15	Max Fuse	e (ODU) (A)	15		
Power Inpu	it (W)	Min.	Rated	Max.		
	Cooling	180	857	1180		
	Heating	370	907	1500		
Current (A)		Min.	Rated	Max.		
	Cooling	0.89	3.72	5.5		
	Heating	1.6	4.1	6.52		

<sup>1.</sup> Cooling Capacity Conditions: Indoor Temperature @ 80°F (26.7°C) DB; 67°F (19.4°C) WB with Outdoor Temperature @ 95°F (35°C) DB; 75°F (23.9°C) WB. Heating Capacity Conditions: Indoor Temperature @ 70°F (21.1°C) DB; 60°F (15.6°C) WB with Outdoor Temperature @ 47°F (8.3°C) DB; 43°F (6.1°C) WB. Line Set @ 25ft (7.5m); Height Difference @ 0ft (0m). 2. COP for all temperatures is @ rated output except when rated output is not given. In that case, COP is @ max. output. 3. System continues to operate below rated outdoor temperature operating range, subject to varying conditions. System has no low temperature cutout. Capacity is not tested outside of the rated temperature range. | Master Group is not responsible for the accuracy and validity of any changes made to this document without the written authorization of Master Group. Specifications subject to change without notice.







DIMENSIONS & WEIGHTS						
Indoor	Net (WxDxH; in.)	33.66x9.09x11.69				
	Gross (WxDxH; in.)	36.22x1	2.20x14.57			
	Net Weight Ibs   kg	22.93	10.4			
	Gross Weight lbs   kg 28.8		13.1			
Outdoor	Net (WxDxH; in.)	31.69x1	12.99x21.81			
	Gross (WxDxH; in.)	4.57x24.21				
	Net Weight Ibs   kg	73.63	33.4			
	Gross Weight Ibs   kg	79.37	36			
KEY FEATURES						
Rotary Inve	<b>✓</b>					
Twin Rotary Inverter Compressor						
Base Pan H	<b>✓</b>					
Crankcase	<b>✓</b>					
INCLUDED ACCESSORIES						
RG10L2(D2HS)/BGEFU1 - Remote Controller						

FAN						
Indoor	Turbo	High	Med.	Low		
CFM	382	335	229	176		
dB(A)		38	33.5	23.5		
Indoor ESP						
Indoor Moi	1.29					
Outdoor M	1324					
Outdoor M	56					
<b>OPTIONAL</b>	OPTIONAL ACCESSORIES⁴					
173109000						
KJR-120L(R						
KJR-120N(X						
KJR-120N1						
24VINTERF						

## **INDOOR UNIT DRAWING**



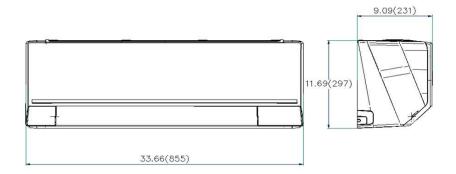




Tag					
inches					
mm					

Drawing dimensions are nominal. Specifications subject to change without notice. 4. Connection of these accessories may require secondary items not listed; refer to full product literature.






## **OUTDOOR UNIT DRAWING**

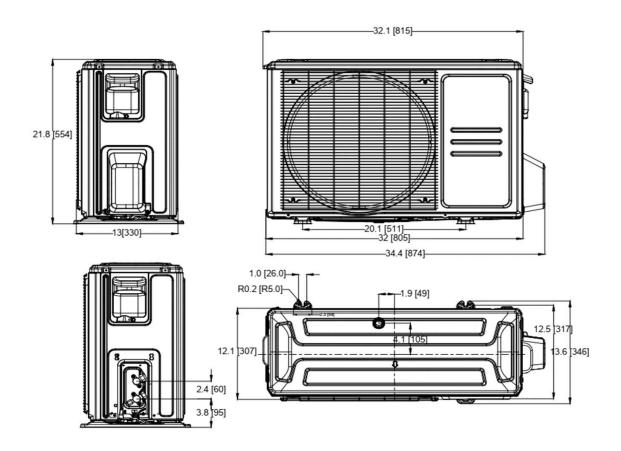

## **OUTDOOR UNIT CLEARANCES**

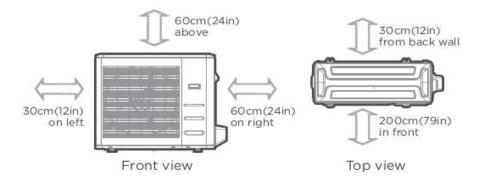

Note: Outdoor units must be elevated 12-24in. (30.5-61cm) above the surface below in heating applications to allow for snow clearance and defrost runoff. Follow local best-practices and guidelines.

Diagrams for reference only.

**NOTES**