



Approval

Construction

SUBMITTAL - 24,000BTU DUCTED - M25

Job Name:							
Location:							
Engineer:	_						
Submitted	•						
Submitted							
WARRANT		2.2					
	0 Years Part	s & Compre	essor				
Terms & Condition	ns Apply.			12.			
TYPE				9			
Air Source	<u>·</u>						
	e Air Source	e Heat Pum	p 🗸				
MODELS							
Indoor			HIDU230X5				
Outdoor		DMA24H0	OS25230E8				
CAPACITY I							
Output (Bti	-	Min.	Rated	Max.			
	Cooling	6100	23000	28200			
	Heating	7500	25000	33000			
	ERFORMAN						
Output (Bti		Min.	Rated	Max.			
	17°F (8.3°C)	7500	25000	33000			
1	7°F (-8.3°C)	5900	20000	22600			
	5°F (-15°C)	5000	20000	20000			
	.3°F (-25°C)	2800		10500			
			TING RANG				
Cooling	-25 ~ 50		-13 ~ 122				
Heating ³	-25 ~ 24		-13 ~ 75	°F			
	REFRIGERA	NT					
Liquid (in.)	3/8"		Gas (in.)	5/8"			
Connection				Flared			
Pre-Charge	25						
Maximum I	164						
Maximum I	82						
Refrigerant	R410A						
Pre-Charge	82.89						
Additional	Charge per	Foot (oz)		0.32			
Oil Type	VG74	Oil V	olume (ml)	620			
Drain Pipe	Drain Pipe O.D. (mm) 25						



Submitted For:

Reference

Date: **Unit Tag: Drawing No.:**



Images for reference only

Images for reference on						
CERTIFIED						
AHRI NO.						
207742517		C U	L) US	ENERGY STAR		
EFFICIENCY	' RATINGS					
SEER2				19		
EER2				12.5		
HSPF2 (4)				11.2		
HSPF2 (5)				8.8		
COP ²	47°F	17°F	5°F	-13°F		
	(8.3°C)	(-8.3°C)	(-15°C)	(-25°C)		
	3.61	2.61	2.3	1.51		
ELECTRICA	L					
Power Sup	oly	(V/Ph/Hz)	208	3-230/1/60		
Voltage Range		(V)		187-253		
MCA (A)	22	Max Fuse	e (ODU) (A)	30		
Power Input (W)		Min.	Rated	Max.		
Cooling		290	1840	2680		
	Heating	650	2030	2660		
Current (A)		Min.	Rated	Max.		
Cooling		2.1	8.5	11.8		
	Heating	4.4	9.3	11.7		

^{1.} Cooling Capacity Conditions: Indoor Temperature @ 80°F (26.7°C) DB; 67°F (19.4°C) WB with Outdoor Temperature @ 95°F (35°C) DB; 75°F (23.9°C) WB. Heating Capacity Conditions: Indoor Temperature @ 70°F (21.1°C) DB; 60°F (15.6°C) WB with Outdoor Temperature @ 47°F (8.3°C) DB; 43°F (6.1°C) WB. Line Set @ 25ft (7.5m); Height Difference @ 0ft (0m). 2. COP for all temperatures is @ rated output except when rated output is not given. In that case, COP is @ max. output. 3. System continues to operate below rated outdoor temperature operating range, subject to varying conditions. System has no low temperature cutout. Capacity is not tested outside of the rated temperature range. | Master Group is not responsible for the accuracy and validity of any changes made to this document without the written authorization of Master Group. Specifications subject to change without notice.





DIMENSIONS & WEIGHTS						
Indoor	Net (WxDxH; in.)	30.47x9.80				
	Gross (WxDxH; in.)	51.38x31.69x12.4				
	Net Weight lbs kg	90.39	41			
	Gross Weight Ibs kg	ross Weight lbs kg 105.82				
Outdoor	Net (WxDxH; in.)	37.24x16.14x31.89				
	Gross (WxDxH; in.)	42.91x19.69x34.84				
	Net Weight lbs kg	124.78	56.6			
	Gross Weight Ibs kg	134.92	61.2			
KEY FEATURES						
Rotary Inverter Compressor						


FAIN					
Indoor	Turbo	High	Low		
CFM		434			
dB(A)	A) 44 41				
Indoor ESP	0-0.64				
Indoor Moi	1.52				
Outdoor Max. CFM				2235	
Outdoor Max. dB(A)				59	
OPTIONAL ACCESSORIES ⁴					


KEY FEATURES	
Rotary Inverter Compressor	
Twin Rotary Inverter Compressor	✓
Base Pan Heater	✓
Crankcase Heater	V

INCLUDED ACCESSORIES

KJR-120L(R1)/EFU1 - Wired Controller

INDOOR UNIT DRAWING

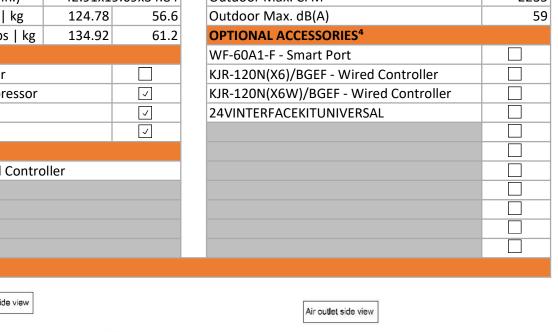

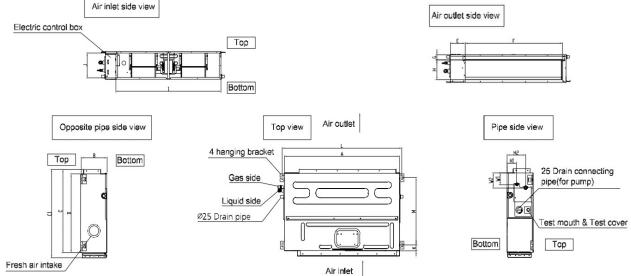


Tag	Α	В	С	C1	D	E	F	G	Н
inches	43.3	9.8	28.9	30.5	27.6	5.5	36.5	2	6.9
mm	1100	249	734	774	700	140	926	50	175
Tag	I	J	K	L	M	H1	H2	W1	W2
inches	39.4	9	2	44.9	23.5	3.1	5.9	5.1	6.1
mm	1001	228	50	1140	598	80	150	130	155

Drawing dimensions are nominal. Specifications subject to change without notice. 4. Connection of these accessories may require secondary items not listed; refer to full product literature.






OUTDOOR UNIT DRAWING

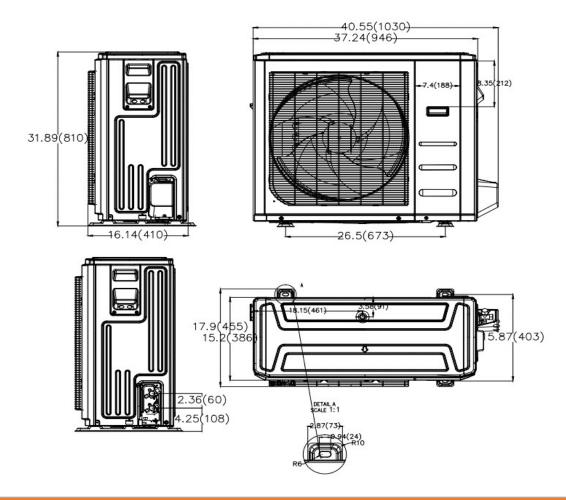

OUTDOOR UNIT CLEARANCES

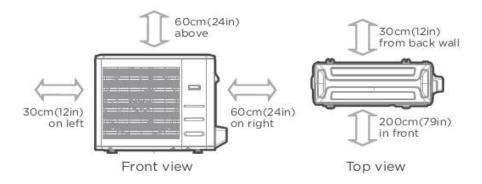

Note: Outdoor units must be elevated 12-24in. (30.5-61cm) above the surface below in heating applications to allow for snow clearance and defrost runoff. Follow local best-practices and guidelines.

Diagrams for reference only.

NOTES