



SUBMITTAL - 36,000BTU MULTI-POSITION AHU

Job Name:							
Location:							
Engineer:							
Submitted By:							
Submitted	То:						
WARRANT	Y						
Standard 10	0 Years Part	s & Compre	ssor	1			
Terms & Condition	ns Apply.						
TYPE							
Air Source I	Heat Pump						
Cold Climat	e Air Source	e Heat Pum _l	ρ 🗸				
MODELS							
Indoor		FMA36HIA	HUU230X7				
Outdoor		DMA36H0	OS20230E7				
CAPACITY I	RANGE ¹						
Output (Btu	u/h)	Min.	Rated	Max.			
	Cooling	13000	36000	47400			
Heating 11000 40000				49000			
HEATING P	ERFORMAN	ICE ²					
Output (Btu	u/h)	Min.	Rated	Max.			
	17°F (8.3°C)	11000	40000	49000			
1	7°F (-8.3°C)	15000	30400	47000			
	5°F (-15°C)	2500	34400	36876			
-2	2°F (-30°C)	12300	21500	21500			
OUTDOOR		URE OPERA	TING RANG	Ε			
Cooling	-15 ~ 50	°C	5 ~ 122	: °F			
Heating ³	-30 ~ 24		-22 ~ 75	°F			
	REFRIGERA	NT					
Liquid (in.)	3/8"		Gas (in.)	3/4"			
Connection				Flared			
Pre-Charge	25						
Maximum I	213.25						
Maximum I	98.42						
Refrigerant	R410A						
Pre-Charge	165.7878						
Additional	0.69						
Oil Type	1460±15						
Drain Conn	ection (inch	ies)		3/4"			



Submitted For:

Reference

Date: Unit Tag:



Approval

Construction

Images for reference only.

			illiages it	or reference only.		
CERTIFIED						
AHRI NO.						
20770	06561	CUL US LISTED ENERGY STAR				
EFFICIENCY	' RATINGS					
SEER2				16		
EER2				10		
HSPF2 (4)				9.5		
HSPF2 (5)				7.8		
COP ²	47°F	17°F	5°F	-22°F		
	(8.3°C)	(-8.3°C)	(-15°C)	(-30°C)		
	3.4	2.46	1.97	1.26		
ELECTRICA	L					
Power Supply		(V/Ph/Hz)	208	8-230/1/60		
Voltage Range		(V)		187-253		
MCA (A)	30	Max Fuse	e (ODU) (A)	50		
Power Inpu	ıt (W)	Min.	Rated	Max.		
Cooling		462	3673	5700		
	Heating	593	3448	5700		
Current (A)		Min.	Rated	Max.		
	Cooling	3.53	15.97	25		
	Heating	4.34	15	25		

^{1.} Cooling Capacity Conditions: Indoor Temperature @ 80°F (26.7°C) DB; 67°F (19.4°C) WB with Outdoor Temperature @ 95°F (35°C) DB; 75°F (23.9°C) WB. Heating Capacity Conditions: Indoor Temperature @ 70°F (21.1°C) DB; 60°F (15.6°C) WB with Outdoor Temperature @ 47°F (8.3°C) DB; 43°F (6.1°C) WB. Line Set @ 25ft (7.5m); Height Difference @ 0ft (0m). 2. COP for all temperatures is @ rated output except when rated output is not given. In that case, COP is @ max. output. 3. System continues to operate below rated outdoor temperature operating range, subject to varying conditions. System has no low temperature cutout. Capacity is not tested outside of the rated temperature range. | Master Group is not responsible for the accuracy and validity of any changes made to this document without the written authorization of Master Group. Specifications subject to change without notice.






DIMENSIONS & WEIGHTS						
Indoor	Net (WxDxH; in.)	21.02x21.02x49.0				
	Gross (WxDxH; in.)	24.41x2	.41x26.57x52.56			
	Net Weight Ibs kg	129.19	58.6			
	Gross Weight lbs kg	155.64	70.6			
Outdoor	Net (WxDxH; in.)	6.34x52.48				
	Gross (WxDxH; in.)	9.49x58.27				
	Net Weight lbs kg 227.		103			
	Gross Weight lbs kg	255.73	116			
KEY FEATURES						
Rotary Inverter Compressor						
Twin Rotary Inverter Compressor						
Base Pan Heater						
Crankcase	✓					
INCLUDED ACCESSORIES						
RG10A(D2S)/BGEFU1 - Remote Controller						
KJR-120N(X6W)/BGEF V1.2 - Wired Controller						
Adaptor for welding(3/8")						
Adaptor for welding(3/4")						

FAN				
Indoor	Turbo	High	Med.	Low
CFM	1188	1082	970	864
dB(A)		45	43	41
Indoor ESP	0-0.80			
Indoor Moisture Removal (I/h)				3.49
Outdoor Max. CFM				4500
Outdoor Max. dB(A)				64
OPTIONAL	ACCESSORI	ES ⁴		
EAH-05B(U				
EAH-10B(U				
EAH-15B(U				
EAH-20B(UL) - 20kW Electric Heater Kit				

INDOOR UNIT DRAWING

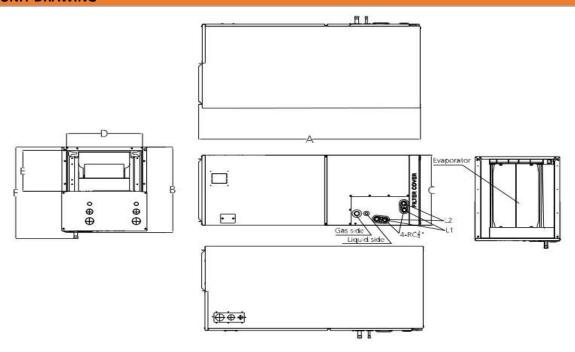

Dimesions D and E are air outlet dimensions.


Tag	Α	В	С	D	E	F	L1	L2
inches	49	21	21	19-5/16	10-1/4	23	Main	Overflow
mm	1245	534	534	490	260	585	Drain	Drain

Drawing dimensions are nominal. Specifications subject to change without notice. 4. Connection of these accessories may require secondary items not listed; refer to full product literature.






OUTDOOR UNIT DRAWING

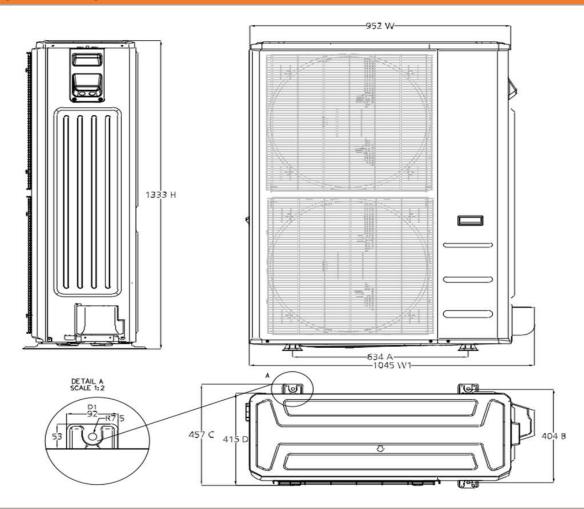

OUTDOOR UNIT CLEARANCES

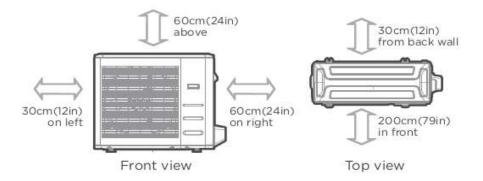

Note: Outdoor units must be elevated 12-24in. (30.5-61cm) above the surface below in heating applications to allow for snow clearance and defrost runoff. Follow local best-practices and guidelines.

Diagrams for reference only.

NOTES

Specifications subject to change without notice.

22023111000251

22023116000164